

MUNICIPAL CORPORATION CHANDIGARH  
Public Health Laboratory at Water Works Sector 39.

TEST - REPORT  
Not for legal use

Ref. No. & Date :- No. GMSSS/22A/2023/359 Date: 30.05.2023  
 Issued to :-  The Principal,  
 Govt. Model. Sr. Sec. School,  
 Sector - 22 - A, Chandigarh.  
 Quantity of sample :- Approximate 1200 ml.  
 Date of Collection :- 30.05.2023  
 Client reference :- Sample collected by Laboratory Staff  
 Packing of sample :- Sample filled in P.P. and Glass Bottle,  
 Source of sample :- from School Tap of Govt. Model. Sr. Sec.  
 School, Sector - 22 - A, Chandigarh.


S. No.	Examination	Quality Standard	Unit	Results
1.	Turbidity	<1.0	N.T.U	0.9
2.	pH	7.0-8.5	-	7.76
3.	Residual Chlorine	0.2 - 0.4	mg/L	0.2
4.	Total Alkalinity (as CaCO <sub>3</sub> )	200	-do-	84
5.	Total Hardness (as CaCO <sub>3</sub> )	200	-do-	72
6.	Chlorides (as Cl)	200	-do-	04
7.	Free & Saline Ammonia	Nil	-do-	NIL
8.	Total Dissolved Solids	500	-do-	132
9.	M.P.N. of Coliform Bacilli per 100ml of water	Zero	M.P.N.	0 (Excellent)

Payment received vide Receipt No.05/2023-24/137576, date:30.05.2023 Amount Rs.3300/-.

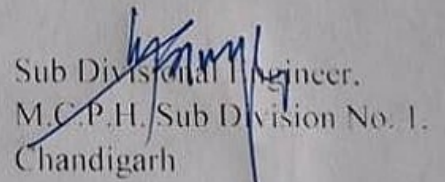
Note:- **Water is fit for drinking.**

Lab. No. MCPHL/23/ 2315

Dated: - 01.06.2023




Chemist  
MCPH Laboratory  
Chandigarh


  
Sub Divisional Engineer,  
M.C.P.H. Sub Division No. 1,  
Chandigarh

Dated \_\_\_\_\_

Endst No. MCPHL/23/ \_\_\_\_\_

Copy forwarded to the Medical Officer of Health Municipal Corporation, Sector-17, Chandigarh for information please.

  
Chemist  
MCPH Laboratory  
Chandigarh

  
Sub Divisional Engineer,  
M.C.P.H. Sub Division No. 1,  
Chandigarh